

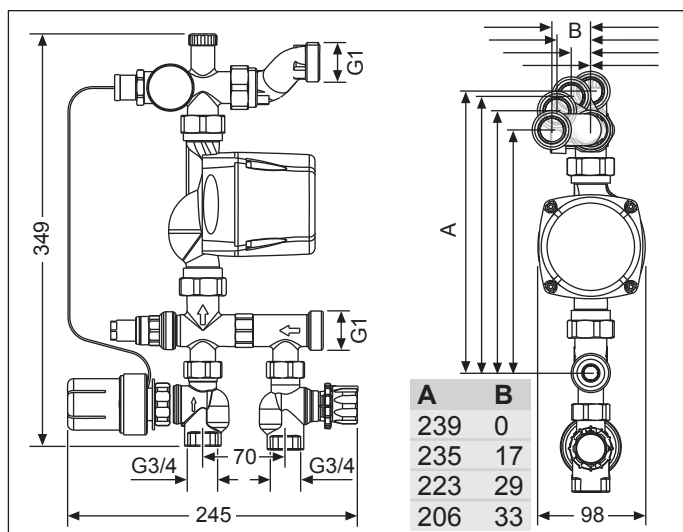


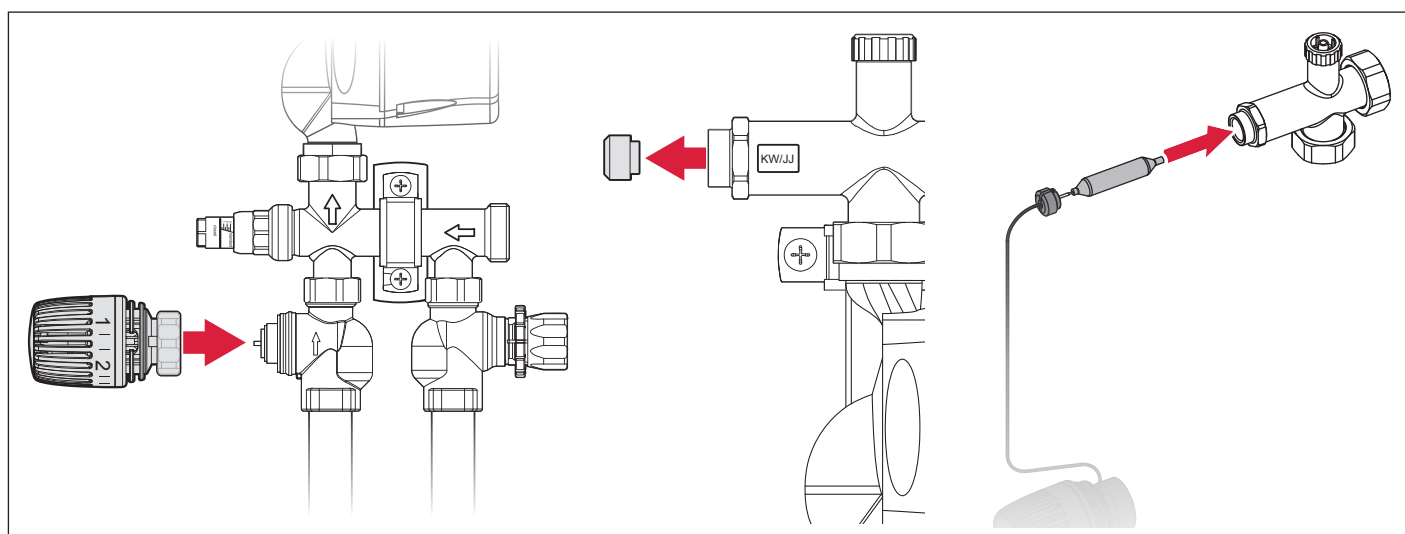

Temperatur	Temperature	
Primär	Primary	20-90° C
Sekundär	Secondary	20-55° C
p max.	p max.	6 bar

Pumpe	Pump	
U	U	230 V, 50 Hz
Q	Q	3,5 m³/h
H	H	6 mWs
P	P	3 ... 42 W
Glykol	Glycol	max. 30 vol%

Ventile	Valves	
Rücklaufventil	Return valve	kvs 2,7 m³/h
Thermostatventil	Thermostic valve	kvs 4,0 m³/h

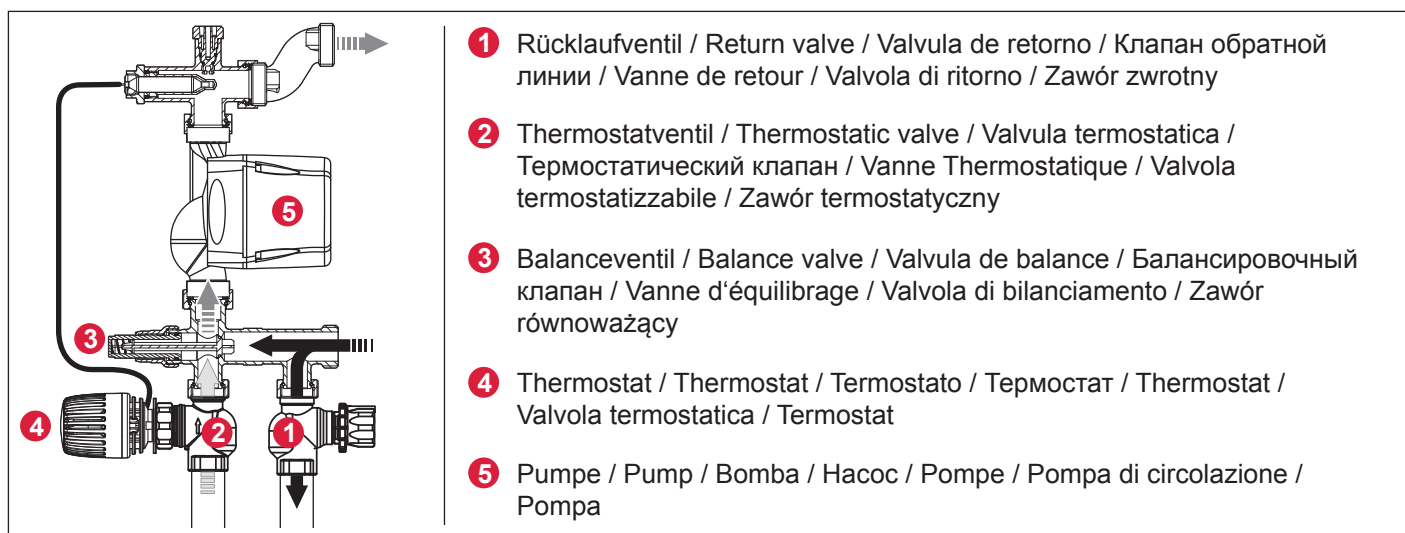

Thermostat

Thermostat

Termostato


Термостат

Thermostat

Valvola termostatica

Termostat

1	20° C
2	25° C
3	30° C
4	34° C
5	38° C
6	42° C
7	46° C
8	50° C
9	55° C

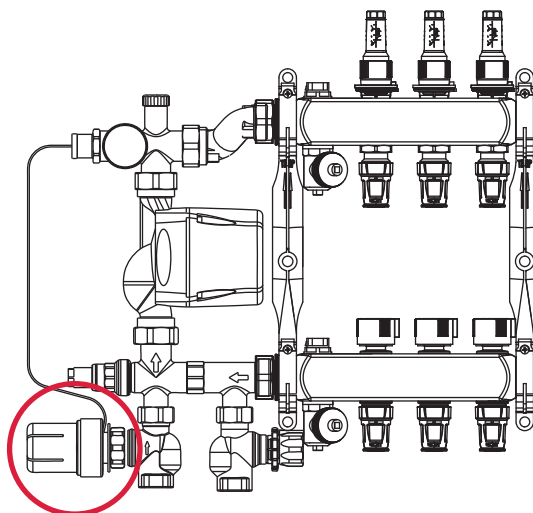

Befüllen

Filling



Llenado

заполнение

Remplissage

Riempimento

Napełnianie

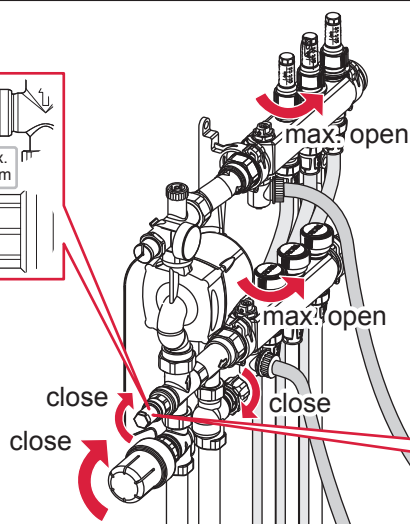

Nach dem Spülen
Ventil öffnen

Open valve after
rinsing

Después de la
descarga abrir la
válvula

Открыть клапан
после промывки

Ouvrir la vanne après
rinçage

Aprire la valvola dopo
il rilavaggio

Otwórz zawór po
przepłukaniu

Entlüften

Venting



Ventilar

Деаэрация




Purger

Sfiatare


Odpowietrzenie

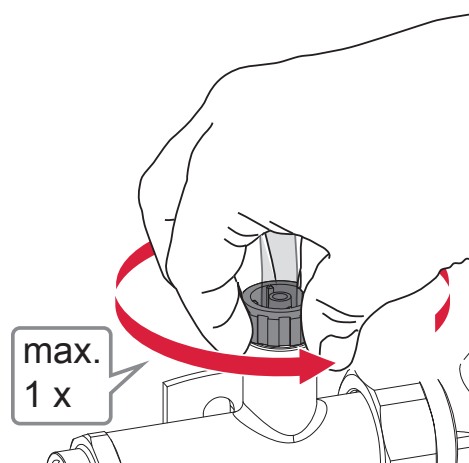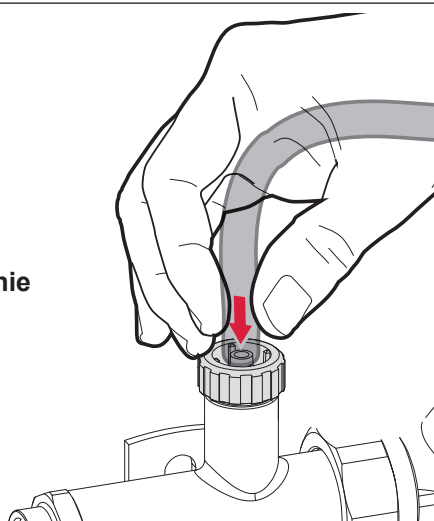



Pumpe / Pump / Bomba / Hacoc / Pompe / Pompa di circolazione / Pompa

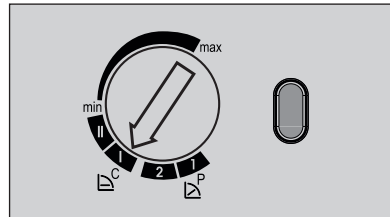

Programm	LED Light
P1/P2 = Δp variabel	green
C1/C2 = Δp constant	orange
Min-Max	blue
Error	red
Air control	white (flashing)

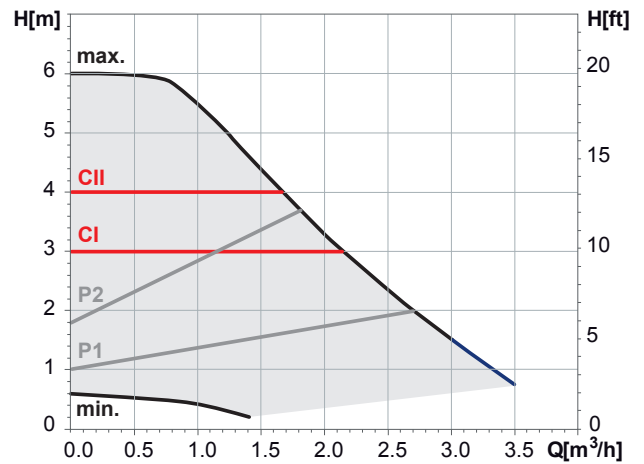

Rücklaufventil
Return valve
Valvula de retorno
Клапан обратной
линии
Vanne de retour
Valvola di ritorno
Zawór zwrotny

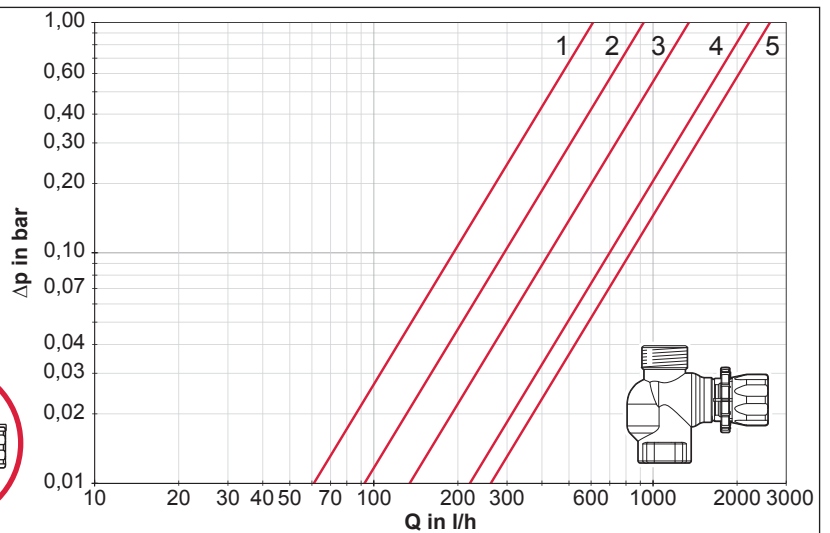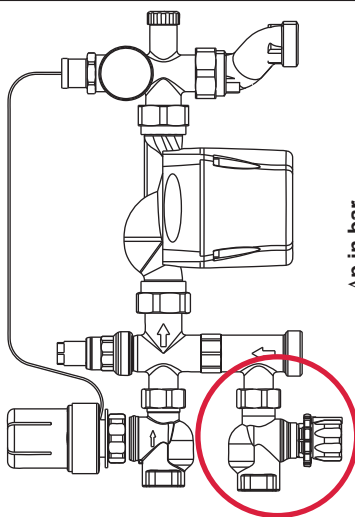

Balanceventil
Balance valve
Valvula de balance
Балансировочный
клапан
Vanne d'équilibrage
Valvola di
bilanciamento
Zawór równoważący

